


# Plans for ISR Activities in 2007 +...

Mu Barrel Technical Board  
CMS week June 20<sup>th</sup> 2006

A. Benvenuti  
INFN Bologna


Filled with old stuff including ex DELPHI Bologna

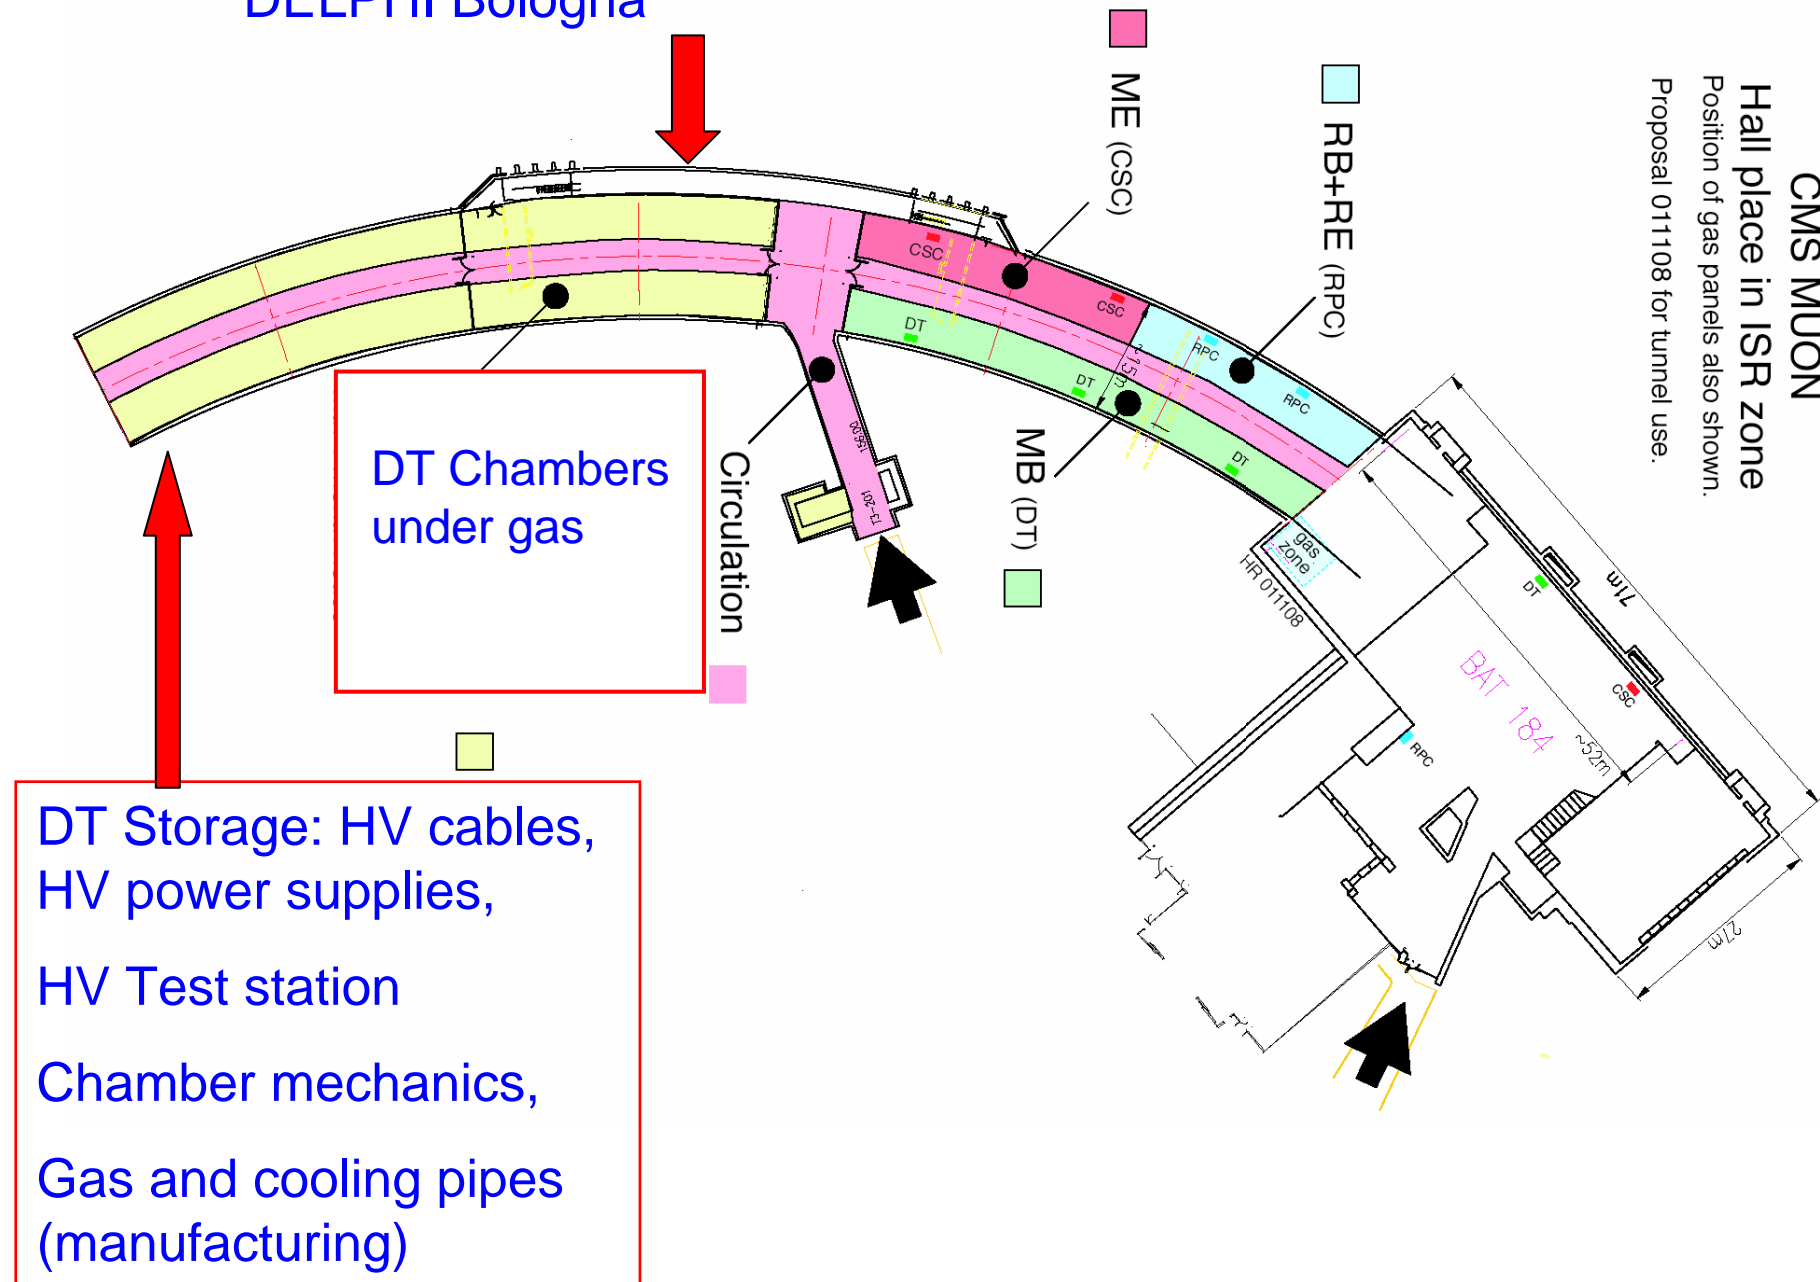


CMS MUON  
Hall place in ISR zone  
Hall 184, lower level  
Position of gas panels also shown.

Update 011108

Cathode production tools (Plotter + 2 dishes) stored in CSC semi-clean area

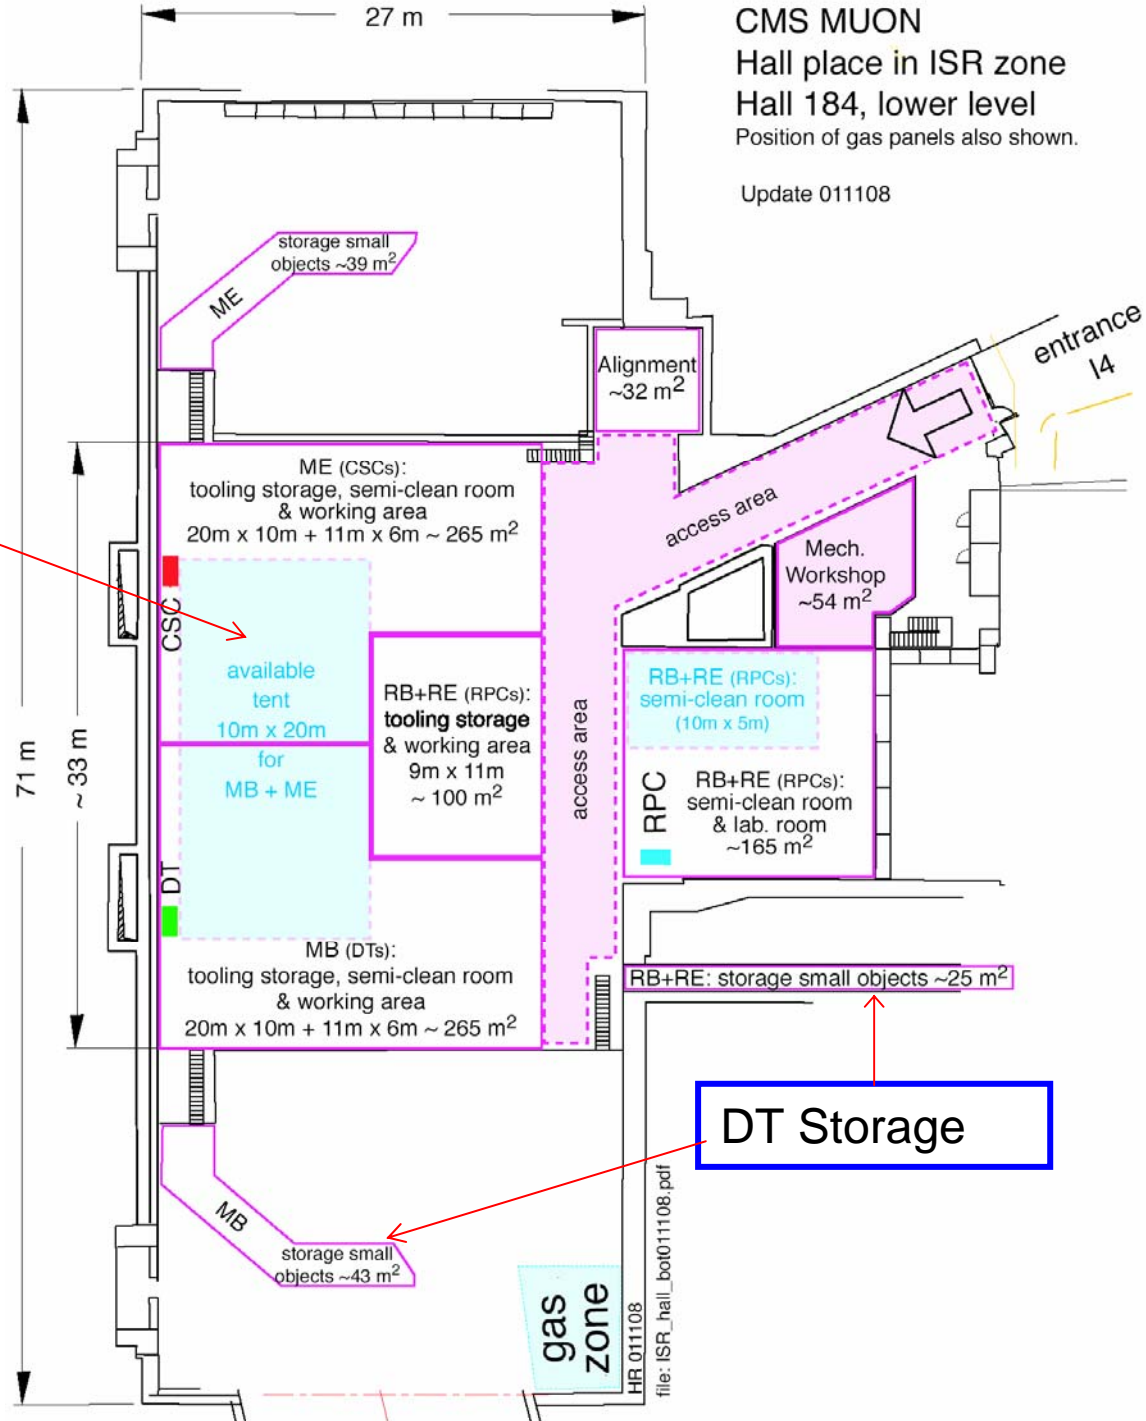

DT Storage

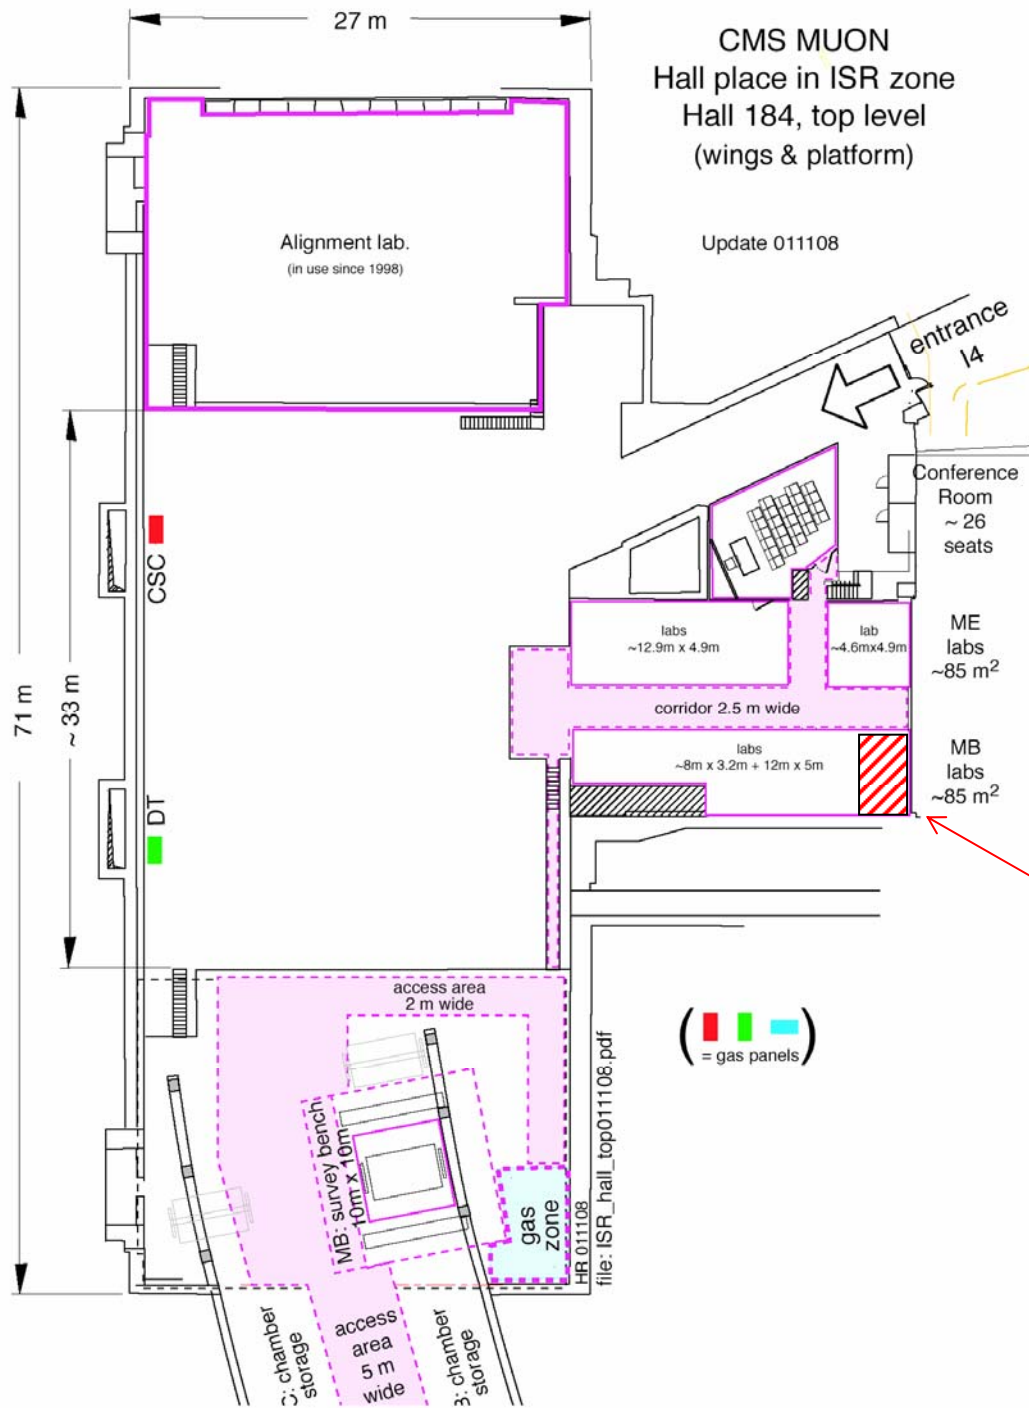

HV cable  
 manufacturing  
 DT (IHEP)

We will be asked to justify the use of this space beyond the middle/end of next year

Some points for DTs:

- Maintain at least the storage areas below I4 Hall and the test area in the I4 side of the I3 tunnel
- Decide the DAQ for the cosmic test stand:
  - external TDCs (pool)
  - minicrate
- What to do with spare chambers at ISR (under gas, HV ?,...)
- Final dressing of spare chambers: leave services free (without HV cables in Phi SLs?)
- I assume that the spare chambers in Aachen and Legnaro (1 +2 ) will stay there until needed. Any other chambers to go back to sites?
- What to do with the cathode assembly tools
- What to do with old HVBs (replaced) and naked pcbs
- Alignment test bench will not be dismantled (check with Gyorgy)